

# Model 330A

## Diaphragm Seals for Threaded Off-Line Process Connections Standard Pressure Rating with Metal Lower Housings

### Process Connection Sizes

1/4" NPTF through 1-1/2" NPTF

### Maximum Pressure Rating

1250, 2500 PSIG (8.63, 17.25 MPa)

@ 100°F (38°C)


(See Notes 1, 2, 3 and 10)

### Dimensional Data

#### Process Connection Size

	1/8" - 1/4"	3/8" - 1"	1-1/4" - 1-1/2"
A	4.25 (208)	4.25 (108)	4.25 (108)
B	2.00 (51)	2.00 (51)	2.00 (51)

( ) Dimensions in millimeters

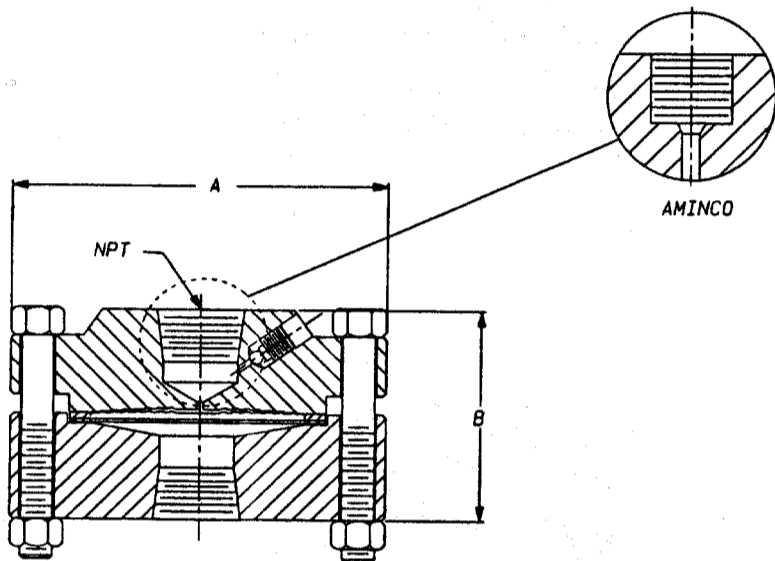

### Standard Features and Options

This threaded connection, off-line seal has a diaphragm welded to the upper housing. This design allows for the use of diaphragm materials that are of a weldable grade. The displacement capability of this series of diaphragm seal is 0.15 cubic inches utilizing a 3" (76 mm) diameter diaphragm.

The standard pressure rating is 2500 PSIG (17.25) when Stainless Steel bolting is not required (See Note 2). The Seal-off and Continuous Duty feature is standard and flushing ports are optional.

Standard instrument connections are 1/4" NPTF and 1/2" NPTF with the 1/4" Aminco as an option. The 1/4" Aminco is a straight thread and cone seat style instrument connection that reduces the amount of fill fluid in the body cavity reducing the amount of error caused by thermal expansion and contraction of fill fluid.

### Offerings

**Lower Materials:** All metallic

**Upper Materials:** Carbon Steel or 316 Stainless Steel

Optional materials are Carpenter 20, Titanium and Monel - Refer to Control Engineering Data for Details.

**Diaphragm Material:** All metallic

**Bolting:** Carbon Steel or 300 Series Stainless Steel (See Notes 1, 2, 3 and 10)

### CONTROL ENGINEERING DATA

D4C2 2 C 2 J 3 T 0 S 0 0 N

(1-2) DIAPHRAGM SEAL DESIGN  
D4 = 330A- Threaded Off-Line

(3-4) LOWER HOUSING MATERIAL (WETTED)  
C2 = Carpenter 20 CB-3  
CS = Carbon Steel  
HB = Hastelloy B3  
HC = Hastelloy C-276  
I6 = Inconel 600  
M4 = Monel 400  
N2 = Nickel 200 (See Note 11)  
S4 = 304 Stainless Steel  
S6 = 316 Stainless Steel  
SF = 304L Stainless Steel  
SL = 316L Stainless Steel  
TI = Titanium - Grade 4 (See Note 11)  
TP = Tantalum Plate (Wetted Surfaces Only)(See Note 8)  
00 = No Lower Housing Required (Upper Housing Only)

(5) SEAL PROCESS CONNECTION (See Note 11)  
2 = 1/4" NPTF  
3 = 3/8" NPTF  
4 = 1/2" NPTF  
5 = 3/4" NPTF  
6 = 1" NPTF  
7 = 1-1/4" NPTF  
8 = 1-1/2" NPTF  
D = 1/4" Aminco  
0 = No Lower Housing Provided (Upper Housing Only)

(6) SEAL PRESSURE RATING @ 100°F (38°C) (See Note 10)  
C = 1250 PSIG (8.62 MPa) (See Note 2)  
U = 2500 PSIG (17.25 MPa) (See Notes 1 and 3)

(7) SEAL INSTRUMENT CONNECTION  
1 = 1/4" NPTF with bleed  
2 = 1/2" NPTF with bleed  
4 = 1/4" AMINCO with bleed

(8) SEAL DIAPHRAGM MATERIAL  
C = Carpenter 20 CB-3 (See Notes 6 and 7)  
D = Hastelloy C-276  
H = Hastelloy B3  
I = Inconel 600  
M = Monel 400 (See Note 7)  
N = Nickel 200  
J = 316L Stainless Steel (See Note 5)  
T = Tantalum  
E = Titanium - Grade 2

(9) SEAL GASKET MATERIAL  
0 = None  
B = Buna "N"  
G = Grafoil  
T = Teflon (See note 4)  
V = Viton  
S = CGR 2750 (Standard)

(10) UPPER HOUSING MATERIAL  
B = Carbon Steel - N.A.C.E. (No Weld Ring)  
F = 316 Stainless Steel - N.A.C.E. (No Weld Ring)  
N = Monel - N.A.C.E. (No Weld Ring)  
C = Carbon Steel (Standard)  
S = 316 Stainless Steel  
M = Monel (See Note 7)  
2 = Carpenter 20 CB-3 (See Notes 6 and 7)  
T = Titanium (See Notes 6 and 7)

(11) FLUSH CONNECTION (Not Shown)  
0 = None (Standard)  
1 = 1/8" NPTF  
2 = 1/4" NPTF  
3 = 1/4" NPTF- DUAL


(12) BOLTING  
0 = None  
C = Carbon Steel, Grade 5 (See Note 1)  
S = 300 Series Stainless Steel (See Note 2)  
H = 300 Series Stainless Steel (Hi-Strength) (See Note 3)

(13) TEFLON COATINGS (See Note 13)  
0 = None (Standard)  
A = Teflon Coated Diaphragm Only  
B = Teflon Coated Diaphragm and Lower Housing

(14) PLATING OPTIONS  
0 = None (Standard)  
G = Gold Plating Diaphragm Only (See Note 12)

(15) FILL LIQUID  
N = (Standard)

CATALOG NUMBERS AS RECEIVED  
FOR THE 330A SERIES MUST CONTAIN  
FIFTEEN (15) CHARACTERS

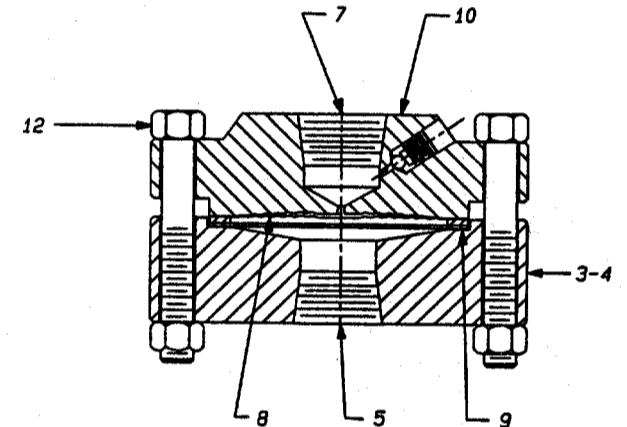

### Notes:

- Using Grade 5 bolts and Grade 5 nuts will maintain the standard 2500 (17.25 MPa) pressure rating chosen in Option 6.
- When using 300 Series Stainless Steel bolts and nuts, the standard 2500 PSIG (17.25 MPa) pressure rating will be reduced by 50% to 1250 PSIG (8.63 MPa), refer to Option 6.
- To maintain the standard 2500 PSIG (17.25 MPa) pressure rating chosen in Option 6 when 300 Series Stainless Steel bolts and nuts are required, then stainless steel high-strength bolts and nuts will be necessary.
- Teflon Gasket is standard for seals with lower housing manufactured of C2, TI and TP.
- Standard diaphragm material is 316L Stainless Steel for seals with lower housing manufactured of CS, S4, S6, SF and SL.
- Standard diaphragm material is tantalum for seals with lower housing manufactured of C2, TP and TI. When customer requires a Carpenter 20, Monel or Titanium diaphragm, refer to Position 10 for proper upper housing material.
- When a Carpenter 20, Monel or Titanium diaphragm is chosen and equivalent upper housing is required.
- Adequate plating coverage of threaded connections cannot be guaranteed due to limitations and nature of the plating/coating process. Tantalum plated lowers cannot be supplied with flush connections.
- N.A.C.E. - Welded diaphragm seals with Hastelloy C-276 or Monel wetted materials of construction will meet the requirements of N.A.C.E. International Document MR-0175-1995. 316 Stainless Steel construction will NOT BE offered in a welded design as meeting N.A.C.E. MR-0175-1995 requirements as the weld area of the diaphragm seal will not meet the maximum hardness specifications within this document.
- Refer to Miscellaneous Data Section for Pressure-Temperature Rating Guide.
- Maximum working pressure limited to 1250 PSIG (8.63 MPa) @ 100°F (38°C) for all lower housings with pipe threads larger than 1/4" NPTF that are constructed of Nickel 200 or with pipe threads larger than 3/4" NPTF that are constructed of Titanium Grade 4 due to connection thread strength limitations
- Tantalum and Titanium materials cannot be gold plated.
- Teflon-S® Coating (FEP Grade).

# Model 330A

## Diaphragm Seals for Threaded Off-Line Process Connections Reduced Pressure Rating for Non-Metallic Lower Housings

### Process Connection Sizes

1/4" NPTF through 1-1/2" NPTF

### Maximum Pressure Rating


200 PSIG (1.38 MPa) at 140°F (60°C) maximum temperature rating (See Note 4)

### Dimensional Data

#### Process Connection Size

	PVC-Kynar-Polypropylene		
	1/8" - 1/4"	3/8" - 1"	1-1/4" - 1-1/2"
A	4.25 (1.08)	4.25 (1.08)	4.25 (1.08)
B	2.00 (52)	2.00 (52)	2.00 (52)
	Teflon-Glass/Carbon Filled		
A	4.25 (1.08)	4.25 (1.08)	4.25 (1.08)
B	2.12 (54)	2.12 (54)	2.12 (54)

( ) Dimensions in millimeters

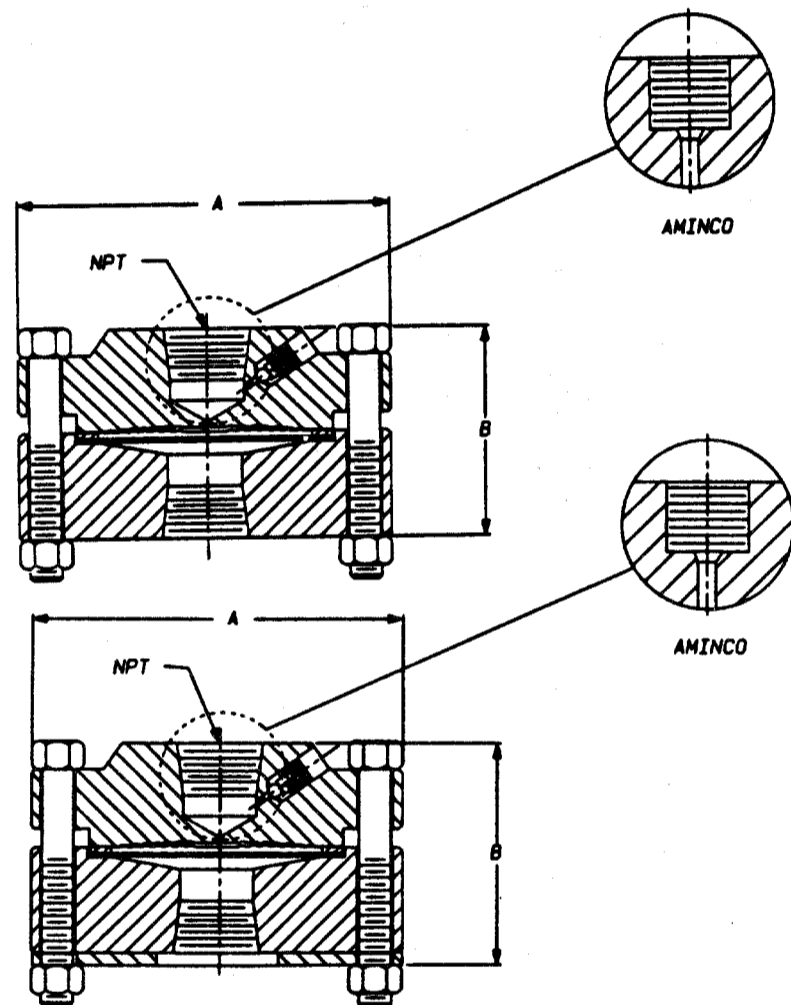

TEFLON LOWER HOUSING

### Standard Features and Options

This threaded connection, off-line seal has a diaphragm welded to the upper housing. This design allows for the use of diaphragm materials that are of a weldable grade. The displacement capability of this series of diaphragm seal is 0.15 cubic inches utilizing a 3.0" (76.20 mm) diameter diaphragm.

The standard pressure rating is 200 PSIG (1.38 MPa) with a maximum temperature of 140°F (60°C). Because of the strength of material, flushing ports are not available. Teflon glass fill lowers, Teflon carbon filled and Teflon Virgin will be supplied with a 316 Stainless Steel lower metal support plate to distribute bolt load and minimize cold flow. A Seal-off feature is standard.



Standard instrument connections are 1/4" NPTF and 1/2" NPTF with the 1/4" Aminco as an option. The 1/4" Aminco is a straight thread and cone seat style instrument connection that reduces the amount of fill fluid in the body cavity reducing the amount of error caused by thermal expansion and contraction of fill fluid.

### CONTROL ENGINEERING DATA

D4TC6G4NBCOS00N

- (15) FILL LIQUID  
N = (Standard)
- (14) PLATING OPTIONS  
0 = None (Standard)  
G = Gold Plating Diaphragm Only (See Note 5)
- (13) TEFLON COATINGS (See Note 6)  
0 = None (Standard)  
A = Teflon Coated Diaphragm Only  
B = Teflon Coated Diaphragm and Lower Housing
- (12) BOLTING (See Note 8)  
0 = None  
C = Carbon Steel, Grade 5  
S = 300 Series Stainless Steel
- (11) FUTURE OPTIONS  
0 = Not Applicable
- (10) UPPER HOUSING MATERIAL  
B = Carbon Steel - N.A.C.E. (No Weld Ring)  
F = 316 Stainless Steel - N.A.C.E. (No Weld Ring)  
N = Monel - N.A.C.E. (No Weld Ring)  
C = Carbon Steel (Standard)  
S = 316 Stainless Steel  
M = Monel (See Note 3)  
2 = Carpenter 20 CB-3 (See Notes 1 and 3)  
T = Titanium (See Notes 1 and 3)
- (9) SEAL GASKET MATERIAL  
0 = None  
B = Buna "N"  
G = Grafoil  
T = Teflon (See Note 2)  
V = Viton  
S = CGR 2750 (Standard)
- (8) SEAL DIAPHRAGM MATERIAL  
C = Carpenter 20 CB-3 (See Notes 1 and 3)  
H = Hastelloy B3  
D = Hastelloy C-276  
I = Inconel 600  
M = Monel 400 (See Note 3)  
N = Nickel 200  
J = 316L Stainless Steel  
T = Tantalum (See Note 1)  
E = Titanium (See Notes 1 and 3)
- (7) SEAL INSTRUMENT CONNECTION  
1 = 1/4" NPTF with bleed  
2 = 1/2" NPTF with bleed  
4 = 1/4" AMINCO with bleed
- (6) SEAL PRESSURE RATING @ 140°F (60°C) (See Note 4)  
G = 200 PSIG (1.38 MPa)
- (5) SEAL PROCESS CONNECTION  
2 = 1/4" NPTF  
3 = 3/8" NPTF  
4 = 1/2" NPTF  
5 = 3/4" NPTF  
6 = 1" NPTF  
7 = 1-1/4" NPTF  
8 = 1-1/2" NPTF  
D = 1/4" Aminco NPT  
0 = No Lower Housing Required (Upper Housing Only)
- (3-4) LOWER HOUSING MATERIAL (WETTED)  
KN = Kynar  
PP = Polypropylene  
PV = PVC  
TC = Teflon-Carbon Filled  
TG = Teflon-Glass Filled  
00 = No Lower Housing Required (Upper Housing Only)
- (1-2) DIAPHRAGM SEAL DESIGN  
D4 = 330A- Threaded Off-Line

CATALOG NUMBERS AS RECEIVED FOR THE 330A SERIES MUST CONTAIN FIFTEEN (15) CHARACTERS

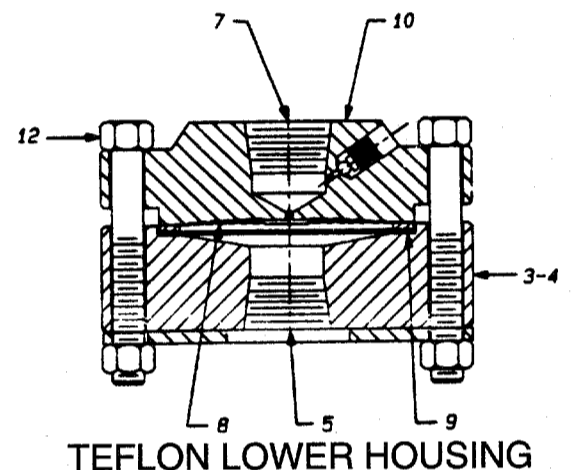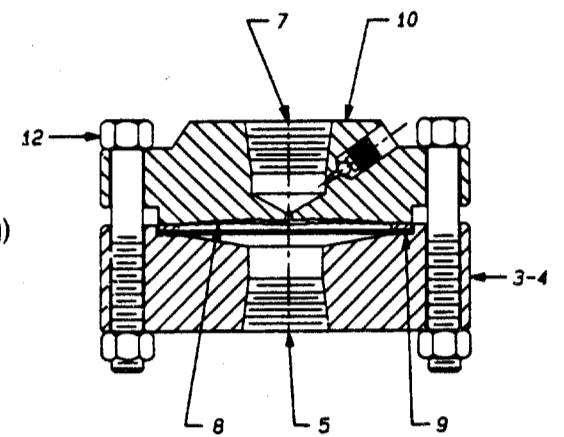

TEFLON LOWER HOUSING

### Notes:

1. Standard diaphragm material is Tantalum for seal lower housings manufactured of KN, PV, PP, TC and TG. When customer requires a Carpenter 20, Monel or Titanium diaphragm, refer to Position 10 for proper upper housing material.
2. Teflon Gasket is standard for seals with lower housing manufactured of KN, PP, PV, TC and TG.
3. When a Monel, Carpenter 20 or Titanium diaphragm is chosen in Position 8, then an equivalent upper housing is required.
4. Refer to Miscellaneous Data Section for Pressure-Temperature Rating Guide.
5. Tantalum and Titanium materials cannot be gold plated.
6. Teflon-S@ Coating (FEP Grade).

### Offerings

**Lower Materials:** All non-metallic

**Upper Materials:** Carbon Steel or 316 Stainless Steel

Optional materials are Carpenter 20, Titanium and Monel - Refer to Control Engineering Data for Details.

**Diaphragm Materials:** All metallic

**Bolting:** Carbon Steel or 300 Series Stainless Steel

**Note:** The use of 300 Series Stainless Steel bolts and nuts will not affect the maximum pressure rating.

# Model 330A

## Diaphragm Seals for Threaded Off-Line Process Connections Elevated Pressure Rating with Metal Lower Housings

### Process Connection Sizes

1/4" NPTF through 1/2" NPTF

### Maximum Working Pressure

5000, 10000, 20000 PSIG (34.50, 69.00, 138.00 MPa) @ 100°F (38°C)

(See Notes 5, 6, 7, 10 and 11)

### Dimensional Data

#### Process Connection Size

Pressure Rating		1/8" - 1/4"	3/8" - 1/2"
5000	A	*	*
	B	*	*
10000	A	*	*
	B	*	*
20000	A	*	*
	B	*	*

\*Consult the factory.

### Standard Features and Options

This threaded connection, off-line seal has a diaphragm welded to the upper housing. This design allows for the use diaphragm materials that are of a weldable grade. The displacement capability of this series of diaphragm seal is 0.15 cubic inches utilizing a 3.0" (76.20 mm) diameter diaphragm.

Pressure ratings of 5000, 10000, and 20000 PSIG (34.50, 69.00 and 138 MPa) are offered when 300 Series Stainless Steel bolting is not required (See Note 6.) The Seal-off feature is standard for these pressure ratings. Also available are flushing ports for the 5000 PSIG (34.50 MPa) rating only.

Standard instrument connections are 1/4" NPTF and 1/2" NPTF with the 1/4" Aminco as an option. The 1/4" Aminco is a straight thread and cone seat style instrument connection that reduces the amount of fill fluid in the body cavity reducing the amount of error caused by thermal expansion and contraction of fill fluid.

### Offerings

**Lower Materials:** All metallic

**Upper Materials:** Carbon Steel or 316 Stainless Steel

Optional materials are Carpenter 20, Titanium and Monel. Refer to Control Engineering Data for details.

**Diaphragm Materials:** All metallic

**Bolting:** Carbon Steel or 300 Stainless Steel (See Notes 5, 6, 7 and 10)

### CONTROL ENGINEERING DATA

D4CS 2 Y 4 H 3 T O S A G N

(15) FILL LIQUID  
N = (Standard)

(14) PLATING OPTIONS  
0 = None (Standard)  
G = Gold Plating Diaphragm Only (See Note 12)

(13) TEFLON COATINGS (See Note 13)  
0 = None (Standard)  
A = Teflon Coated Diaphragm Only  
B = Teflon Coated Diaphragm and Lower Housing

(12) BOLTING  
0 = None  
C = Carbon Steel, Grade 5 (See Note 5)  
S = 300 Series Stainless Steel (See Note 6)  
H = 300 Series Stainless Steel Hi-Strength (See Note 7)

(11) FLUSH CONNECTION (Not Shown)  
0 = None (Standard)  
1 = 1/8" NPTF  
2 = 1/4" NPTF  
3 = 1/4" NPTF- DUAL

(10) UPPER HOUSING MATERIAL  
B = Carbon Steel - N.A.C.E. (No Weld Ring)  
F = 316 Stainless Steel - N.A.C.E. (No Weld Ring)  
N = Monel - N.A.C.E. (No Weld Ring)  
C = Carbon Steel (Standard)  
S = 316 Stainless Steel  
M = Monel (See Note 3)  
2 = Carpenter 20 CB-3 (See Notes 2 and 3)  
T = Titanium (See Notes 2 and 3)

(9) SEAL GASKET MATERIAL  
0 = None  
3 = 316 Stainless Steel / Silver Plated  
H = Hastelloy C / Silver Plated

(8) SEAL DIAPHRAGM MATERIAL  
C = Carpenter 20 CB-3 (See Notes 2 and 3)  
H = Hastelloy B3  
D = Hastelloy C-276  
I = Inconel 600  
M = Monel 400 (See Note 3)  
N = Nickel 200  
J = 316L Stainless Steel (See Note 1)  
T = Tantalum (See Note 2)  
E = Titanium - Grade 2 (See Notes 2 and 3)

(7) SEAL INSTRUMENT CONNECTION  
1 = 1/4" NPTF with bleed  
2 = 1/2" NPTF with bleed  
4 = 1/4" AMINCO with bleed

(6) SEAL PRESSURE RATING @ 100°F (38°C)  
(See Notes 5, 6, 7, 10 AND 11)  
U = 2500 PSIG (17.25 MPa)  
W = 5000 PSIG (34.50 MPa)  
Y = 10000 PSIG (69.00 MPa)  
Z = 20000 PSIG (138.00 MPa)

(5) SEAL PROCESS CONNECTION (See Note 11)  
2 = 1/4" NPTF  
3 = 3/8" NPTF  
4 = 1/2" NPTF  
D = 1/4" AMINCO  
0 = No Lower Housing Required (Upper Housing Only)

(3-4) LOWER HOUSING MATERIAL (WETTED)  
C2 = Carpenter 20 CB-3  
CS = Carbon Steel  
HB = Hastelloy B3  
HC = Hastelloy C-276  
I6 = Inconel 600  
M4 = Monel 400  
S4 = 304 Stainless Steel  
S6 = 316 Stainless Steel  
SF = 304L Stainless Steel  
SL = 316L Stainless Steel  
TP = Tantalum Plate (Wetted Surfaces Only) (See Note 8)  
00 = No Lower Housing Required (Upper Housing Only)

(1-2) DIAPHRAGM SEAL DESIGN  
D4 = 330A- Threaded Off-Line

CATALOG NUMBERS AS RECEIVED  
FOR THE 330A SERIES MUST CONTAIN  
FIFTEEN (15) CHARACTERS

### Notes:

- Standard diaphragm material is 316L Stainless Steel for seals with lower housing manufactured of CS, S4, S6, SF and SL.
- Standard diaphragm material is Tantalum for seals with lower housing manufactured of C2, TP and T1. When customer requires a Carpenter 20, Monel or Titanium diaphragm, refer to Position 10 for proper upper housing material.
- When a Monel, Carpenter 20 or Titanium diaphragm is chosen in Positioner 8, then an equivalent upper housing material is required.
- For 5000 PSIG (34.50 MPa) rated seals only.
- Using Grade 5 bolts and Grade 5 nuts will maintain the pressure rating chosen in Option 6.
- When using 300 Series Stainless Steel bolts and nuts, the pressure rating will be reduced by 50%, refer to Option 6.
- When Stainless Steel bolts and nuts (NOT HIGH-STRENGTH) are required, then a de-rated option is required when developing a catalog number.
- To maintain the pressure rating chosen in Option 6 when 300 Series Stainless Steel bolts and nuts are required, then stainless steel high-strength bolts and nuts will be necessary.
- Adequate plating coverage of threaded connections cannot be guaranteed due to limitations and nature of the plating/coating process. Tantalum plated lowers cannot be supplied with flush connections.
- N.A.C.E. - Welded diaphragm seals with Hastelloy C-276 or Monel wetted materials of construction will meet the requirements of N.A.C.E. International Document MR-0175-1995. 316 Stainless Steel construction will NOT BE offered in a welded design as meeting N.A.C.E. MR-0175-1995 requirements as the weld area of the diaphragm seal will not meet the maximum hardness specifications within this document.
- Refer to Miscellaneous Data Section for Pressure-Temperature Rating Guide.
- Maximum working pressures listed are the ratings for the diaphragm seal design NOT for the process connection pipe threads. Pipe threads are not recommended for high pressure systems experiencing dynamic loads. Refer to applicable industry codes and standards for guidelines.
- Tantalum and Titanium materials cannot be gold plated.
- Teflon-S® Coating (FEP Grade).